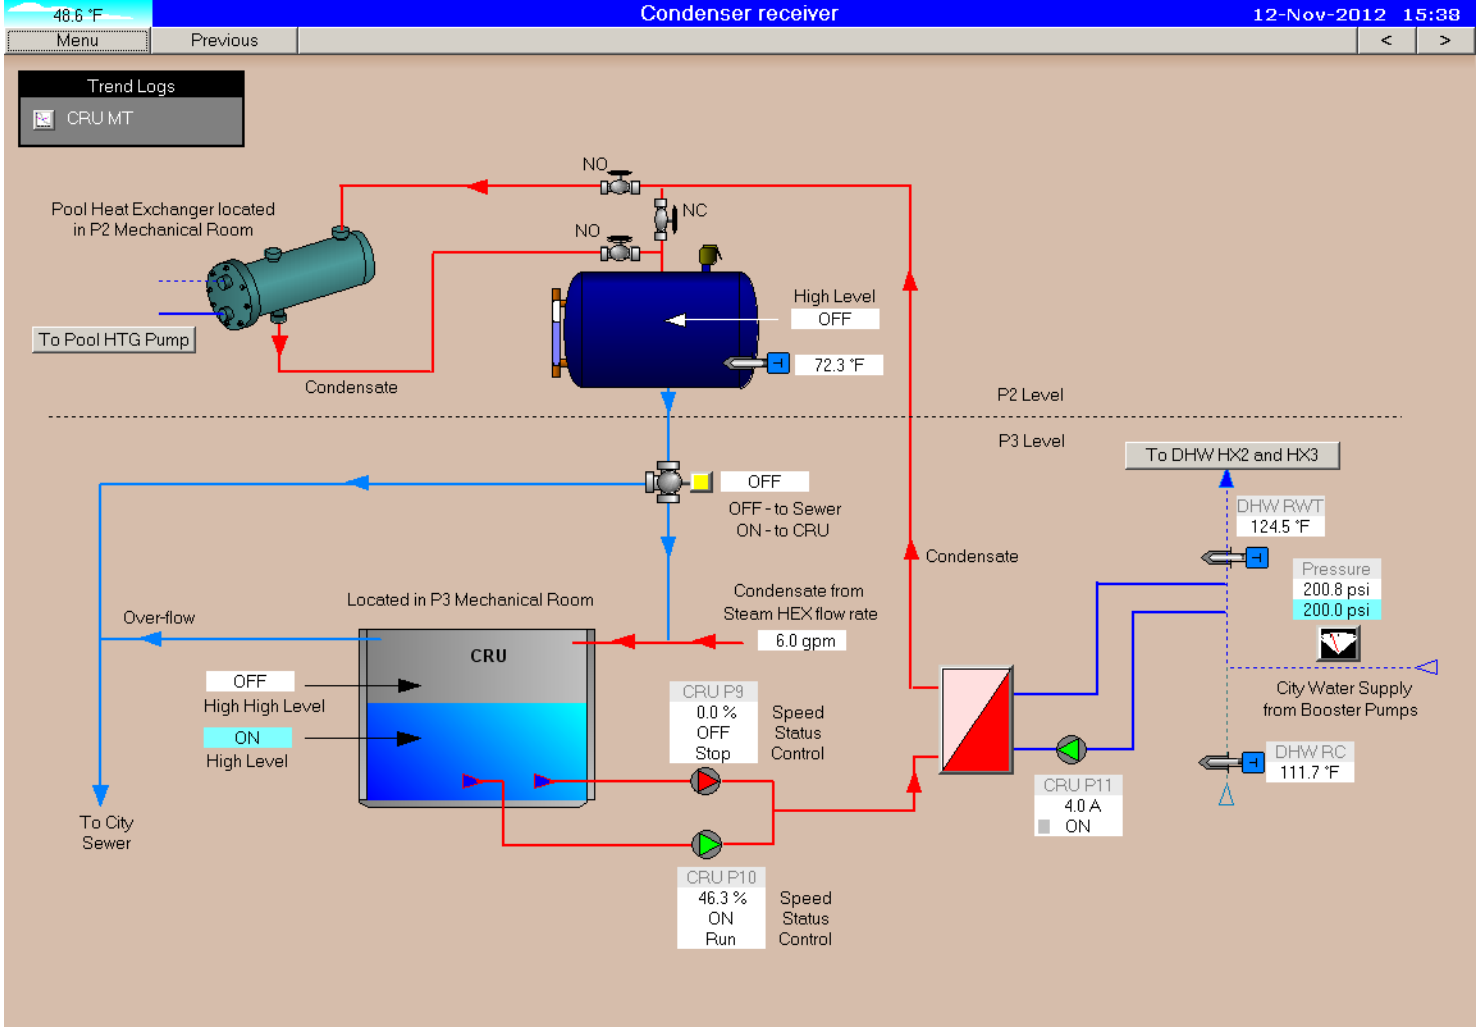
48.6 °F
Condenser receiver
12-Nov-2012 15:38
Menu
Previous
<
>
Trend Logs
CRU MT
NO
NC
NO
Pool Heat Exchanger located in P2 Mechanical Room
To Pool HTG Pump
Condensate
High Level
OFF
72.3 °F
P2 Level
P3 Level
To DHW HX2 and HX3
OFF
OFF - to Sewer
ON - to CRU
DHW RWT
124.5 °F
Condensate
Pressure
200.8 psi
200.0 psi
Located in P3 Mechanical Room
Over-flow
Condensate from Steam HEX flow rate
6.0 gpm
CRU
OFF
High High Level
ON
High Level
CRU P9
0.0 %
OFF
Stop
Speed
Status
Control
City Water Supply from Booster Pumps
DHW RC
111.7 °F
CRU P11
4.0 A
ON
To City Sewer
CRU P10
46.3 %
ON
Run
Speed
Status
Control